

HYDROGUARD® XP Series SH1430 2 Valve Hi/Lo Supply Fixture Wall Mount Cabinet

Product Specification

Features ■

- Paraffin-based advanced thermal actuation technology to sense and adjust outlet temperature
- Dirt and lime resistant poppet and seat design
- Virtual shutoff if supply pressure fails
- Vandal-resistant locking mechanism to secure temperature setting
- Factory tested as a complete unit
- Pressure/Temperature Gauge, Ball valves
- Stainless steel or white painted cabinet


Specifications ■

- Connections See chart on reverse
- Maximum Hot Water Supply Temperature 200°F (93°C)
- Minimum Hot Water Supply Temperature* ... 5°F (3°C) Above Set Point
- Minimum Flow** 0.5 gpm (1.9 lpm)
- Maximum Operating Pressure 125psi (861 kPa)
- Temperature Adjustment Range*** 90 – 160°F (32 – 71°C)
- Hot Water Inlet Temperature Range 120 – 180°F (49 – 82°C)
- Cold Water Inlet Temperature Range 40 – 80°F (4 – 27°C)
- Listing/Compliance (Valve Only) ASSE 1017, CSA B125

**With Equal Pressure*

***Minimum flow when HiLo valve is installed at or near hot water source recirculating tempered water with a properly sized continuously operating recirculating pump.*

****Note: Low limit cannot be less than the cold water temperature. For best operation, hot water should be at least 5°F (3°C) above desired set point.*

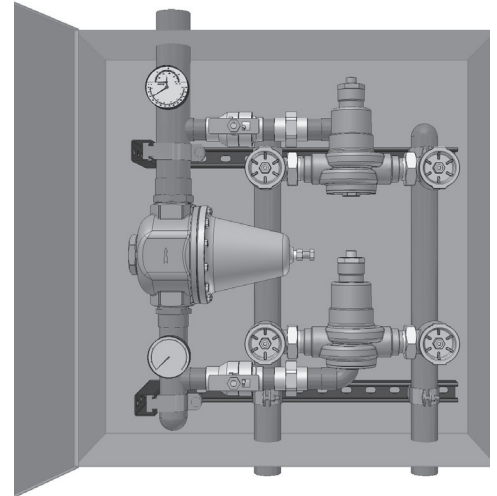



Advanced Thermal Activation

Capacity ■

Flow Capacity at 50-50 Mixed Ratio								
Model	Min. Flow to ASSE 1017	Cv	Pressure Drop Across Valve					
			5psi (34 kPa)	10psi (69 kPa)	20psi (138 kPa)	30psi (207 kPa)	45psi (310 kPa)	60psi (414 kPa)
SH1432HL	1 gpm	30.0	67 gpm	95 gpm	134 gpm	164 gpm	201 gpm	232 gpm
	4 lpm		254 lpm	360 lpm	507 lpm	621 lpm	761 lpm	878 lpm
SH1434HL	1 gpm	40.4	90 gpm	128 gpm	181 gpm	221 gpm	271 gpm	313 gpm
	4 lpm		341 lpm	485 lpm	685 lpm	837 lpm	1026 lpm	1185 lpm

Dimensions ■

SH1430 Hi/Lo System (HL) Wall Mount Cabinet

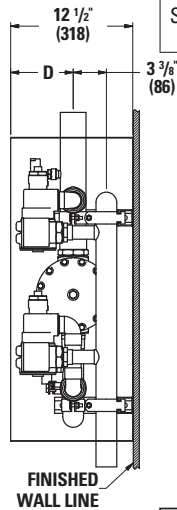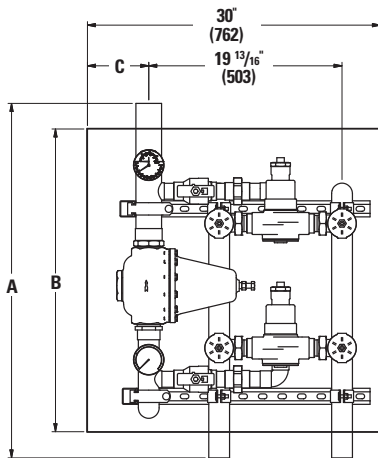


Valve	Inlets	Outlet	PRV	A	B	C	D
SH1432HL	1-1/2" (40)	2" (50)	1-1/2" (40)	35-1/4" (685)	30" (762)	5-1/8" (130)	6-5/8" (168)
SH1434HL	2" (50)	2-1/2" (65)	2" (50)	36-3/8" (924)	31" (787)	6-1/4" (159)	6-1/2" (165)

Note:
Dimensions are shown $\pm 1/2''$
Dimensions in brackets are in mm

Ordering Information ■

Valve	Inlets	Outlet	Order Code
MM434/SH1432	1-1/2" (40mm)	2" (50mm)	SH1432HL
MM434/SH1434	2" (50mm)	2-1/2" (65mm)	SH1434HL
Finish			
Rough Bronze			A
Piping			
Bottom/Top			E
Cabinets			
Stainless, Wall Mount			Q
Painted, Wall Mount			U
Alarm (not factory installed)*			
None			0
AquaSentry® 2** for SH1432HL			6
AquaSentry® 2** for SH1434HL			7
View Port			
None			0
Window			W

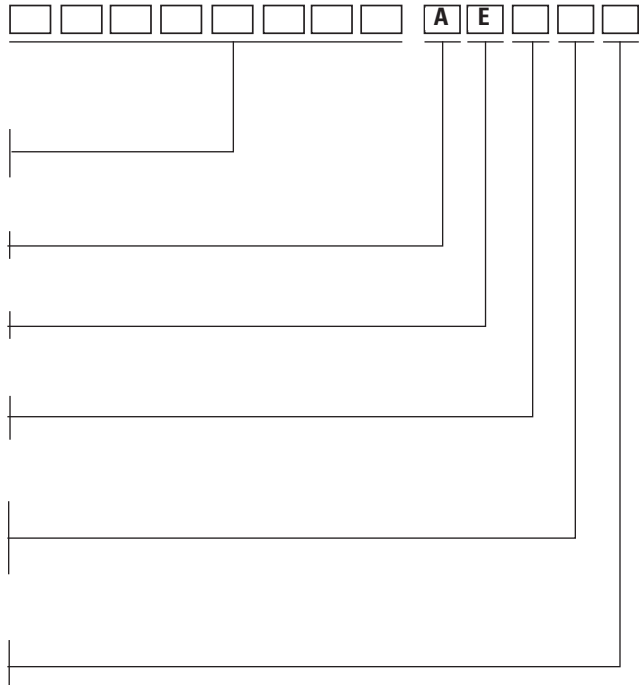

* Mounting requirements vary based on individual installation.

** Includes control module, sensor, electrical box, transformer, solenoid, shock absorber, and 25' of station cable.

Recirculation Piping Diagram ■

Please see Piping Diagram Section of this catalog.

Typical Specification ■

Hi/Lo water temperature control system shall be factory assembled and tested and include a stainless steel or painted steel cabinet. It shall include two thermostatic mixing valves capable of maintaining water temperature to 5°F (3°C) above set point. Hi/Lo shall include HydroGuard® XP MM430 and SH1430 Series Master-Tempering Valve with advanced, paraffin-based actuation technology. Hi/Lo shall also include copper piping, ball valve(s) and temperature/pressure gauge for diagnostics. The tempering valve shall have union checkstops, an outlet temperature range of 90 – 160°F (32 – 71° C) (with lockable means), and a single-seat design for positive shutoff. Valve shall be ASSE 1017 listed and CSA certified. Minimum flows to ASSE 1017 shall be 1.0 gpm (4 lpm) for SH1432HL and SH1434HL.

Valve shall be a Powers' model _____. All alternatives must have written approval prior to bidding.

POWERS™

A Watts Water Technologies Company

ENGINEERING APPROVAL

Project: _____
Contractor: _____
Architect/Engineer: _____



USA: Phone: 1.800.669.5430 • Fax 1.847.229.0526 • www.powerscontrols.com
Canada: Phone: 1.888.208.8927 • Fax 1.888.479.2887 • www.powerscontrols.ca